

**NOTES:**


1 Number of bars required will vary depending on the length of the end section.

Bar No. 1 shall be located 150mm above flow line.

A This OPSD shall be read in conjunction with OPSP 801.040, 801.041, and 801.042.

B Toe plate extensions shall be the same thickness and material as end section. Dimensions shall be overall width less 150mm by 200mm high.

C All dimensions are in millimetres unless otherwise shown.

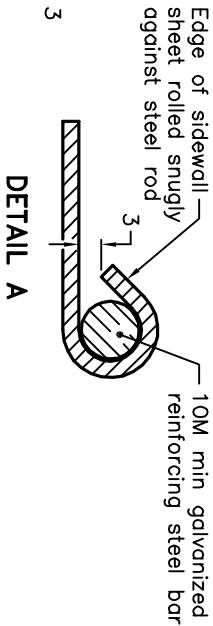

ONTARIO PROVINCIAL STANDARD DRAWING

Nov 2017

Rev 3

CULVERT AND SEWER  
SAFETY SLOPE END TREATMENT  
INSTALLATION DETAILS

OPSP 801.043

